


FLOW PROCESS

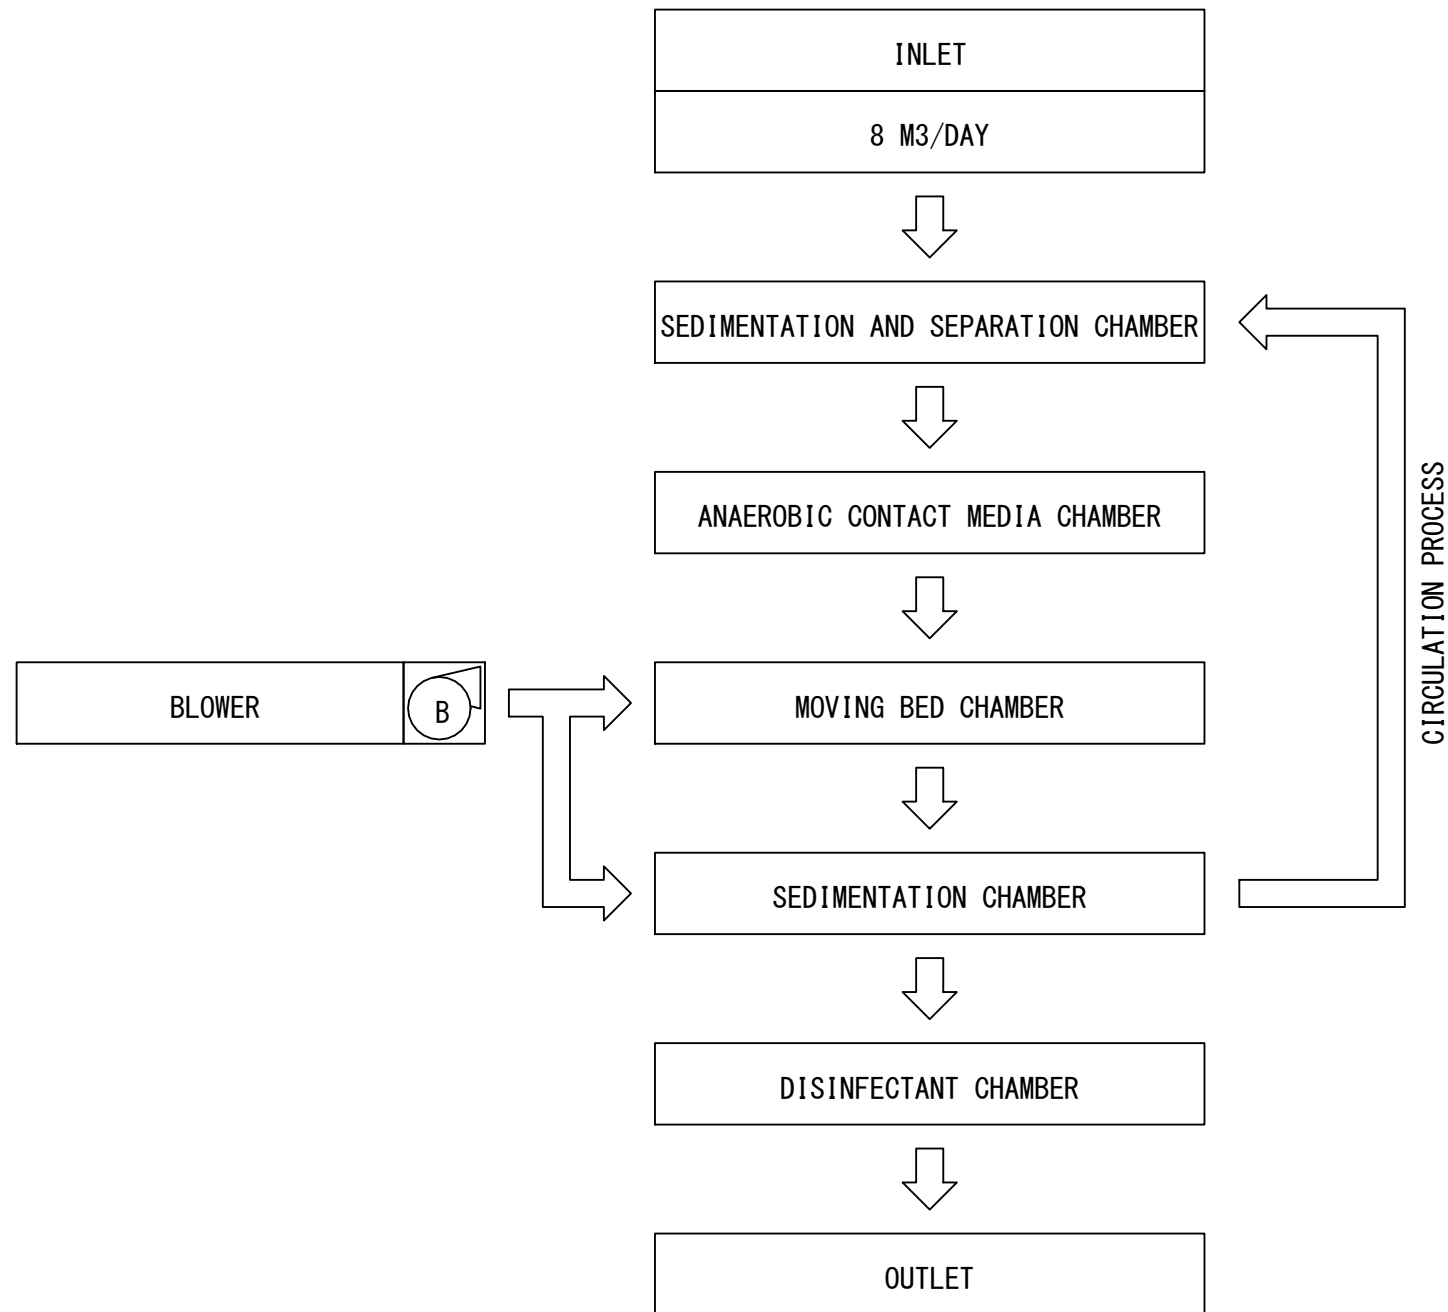

SPECIFICATION BA-8

Design Flow	8 m3/day
Influent BOD	300 mg/Lt
Effluent BOD	20 mg/Lt
Tank Weight	860 kg
Operation Weight	9505 kg

EFFECTIVE CAPACITY

Sedimentation And Separation Chamber	2.938 m3
Anaerobic Contact Media Chamber	2.720 m3
Moving Bed Chamber	1.683 m3
Sedimentation Chamber	1.265 m3
Disinfectant Chamber	0.059 m3

ATTACHMENTS SPECIFICATION

Equipment Name	Voltage	Bore mm	Capacity Lt/min	Motor W	Qty	Pressure /Head
Blower	220	13	118	128	1	20 kPa

MANHOLE SPECIFICATION

Loading Capacity T-0			
Mark	Measurement	Qty	Note
K1	FRP Manhole ϕ 600	3	By Daiki Axis

INTERIOR PARTS SPECIFICATION

Waste Water Pipe	PVC D or AW
Air Pipe	PVC AW
Air Valve	PVC AW
Pipe Support	FRP

NOTE

NOTE :

– ALL DIMENSIONS ARE IN MM

REFERENCE :

LEGEND :



PROJECT NAME :

–
–

DRAWING TITTLE :

STP
FLOW DIAGRAM & SPECIFICATION

NAME OF PLANT :

BA-8
(CAP. 8 m3 / day)


FILE NAME	–	
DATE	–	
DRAWING NO.	SCALE	SHEET NO.
–	NTS	1 of 2

AGREEMENT


DRAWN BY	09/12/21	RAYHAN
CHECKED BY	09/12/21	DEDI
APPROVED BY	09/12/21	MURAKAMI

REVISION


NO.	REV	DATE	DESCRIPTION	DRAWN
1	c	09/12/21	Design	RAYHAN
2				
3				

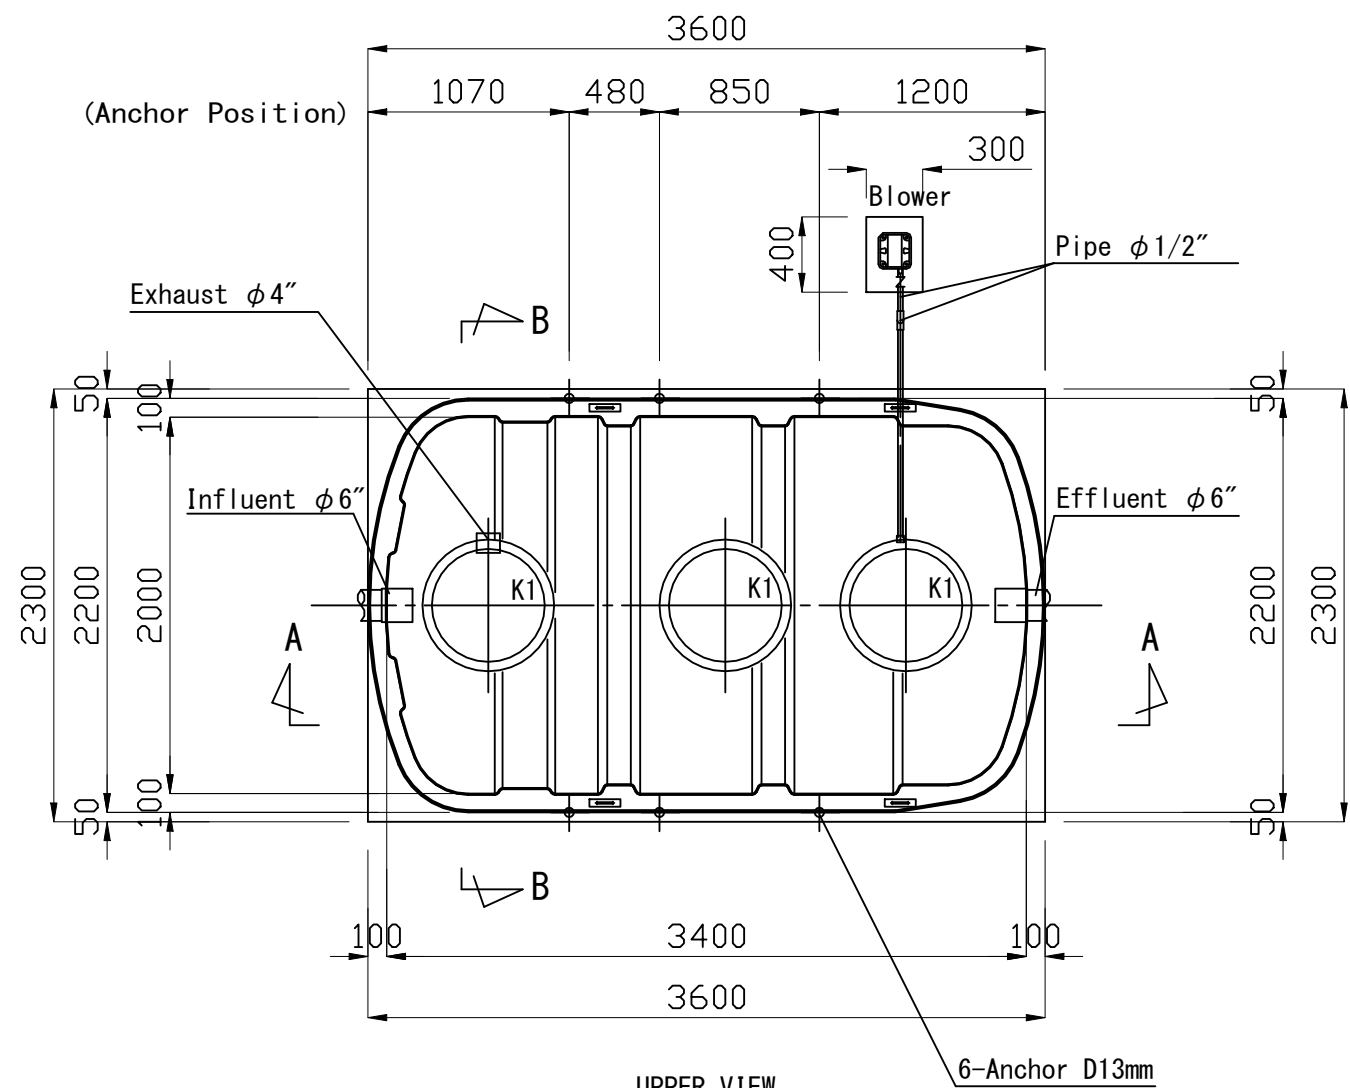

UPPER VIEW

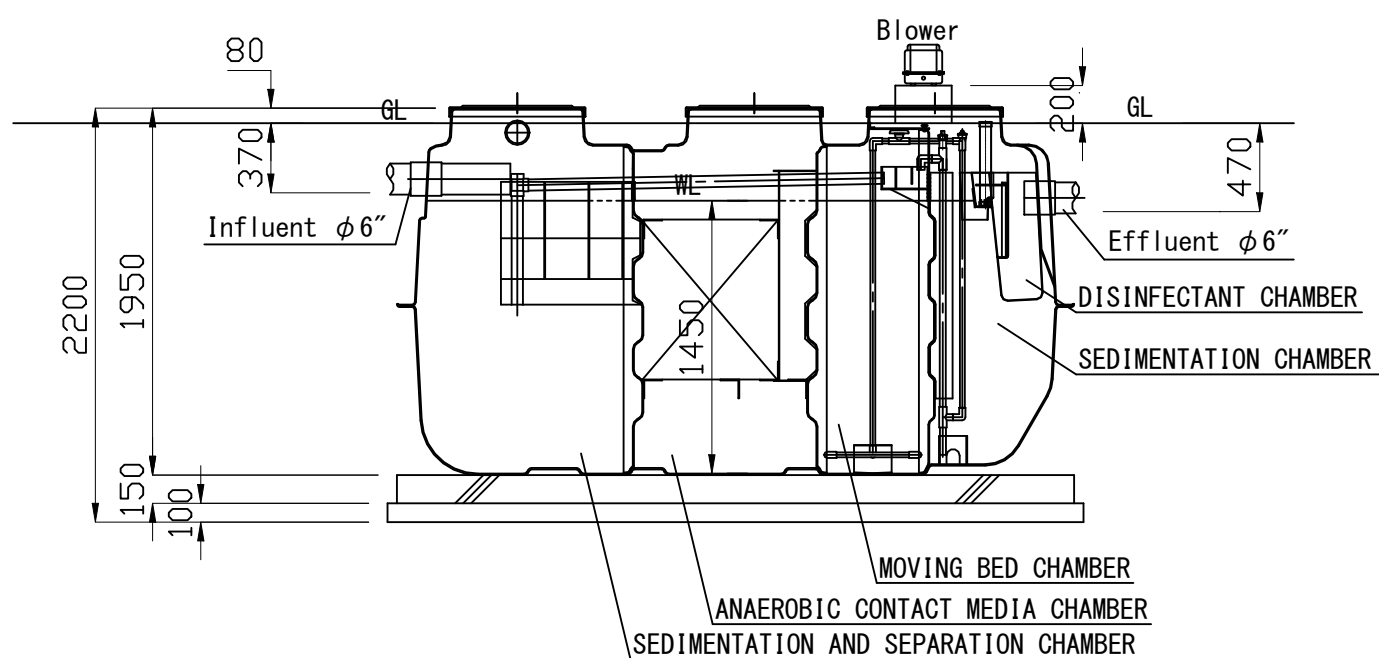

A-A SECTION

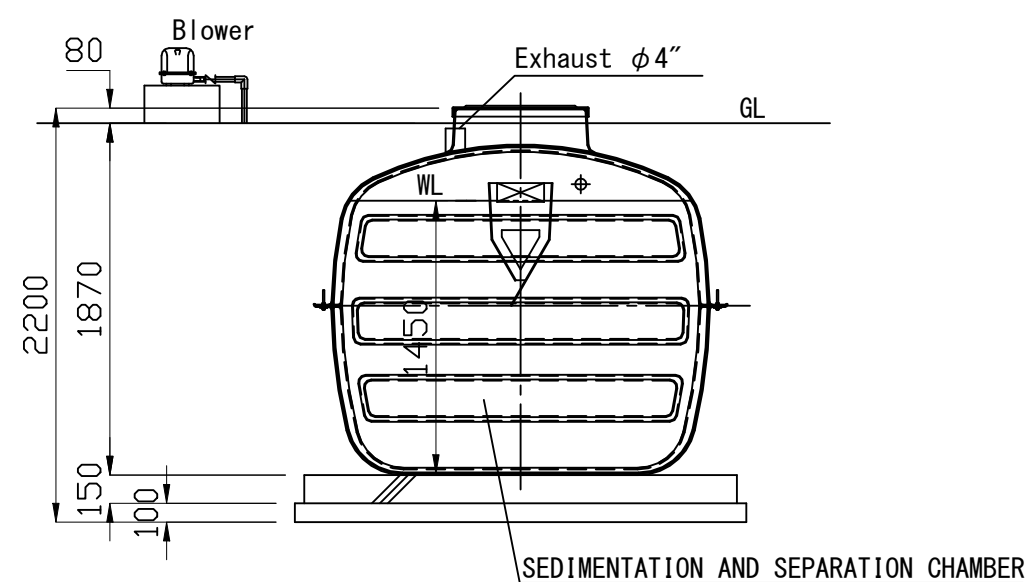

B-B SECTION

NOTE

NOTE :

- ALL DIMENSIONS ARE IN MM

REFERENCE :

LEGEND :

Plaza Mahu 3rd Floor
Jl. KH. Abdurrahman Syafe'i No. 39 B
Bakit Duri, Tebet, Jakarta Selatan
*Telp : 021-83791186, 83794022
*Fax : 021-83793954

Daiki
AXIS INDONESIA
PT. DAIKI AXIS INDONESIA

PROJECT NAME :

-
-

DRAWING TITTLE :

STP
LAYOUT & SECTION

NAME OF PLANT :

BA-8
(CAP. 8 m³ / day)

FILE NAME	-	
DATE	-	
DRAWING NO.	SCALE	SHEET NO.
-	NTS	2 of 2

AGREEMENT

DRAWN BY	09/12/21	RAYHAN
CHECKED BY	09/12/21	DEDI
APPROVED BY	09/12/21	MURAKAMI

REVISION

NO.	REV	DATE	DESCRIPTION	DRAWN
1	c	09/12/21	Design	RAYHAN
2				
3				